NOTES THIS SHEET

1. PROVIDE HWS/HWR PIPING, INSULATION, HANGERS, AND SUPPORTS COMPLETE.
2. RELOCATE STORED THERMOSTAT. PROVIDE ADDITIONAL CONTROL WIRING AS REQUIRED.
3. SEE SHUT-OFF BOX DETAILS FOR PIPING CONNECTION.
4. BALANCE TO GPM INDICATED ON VAV SCHEDULE.

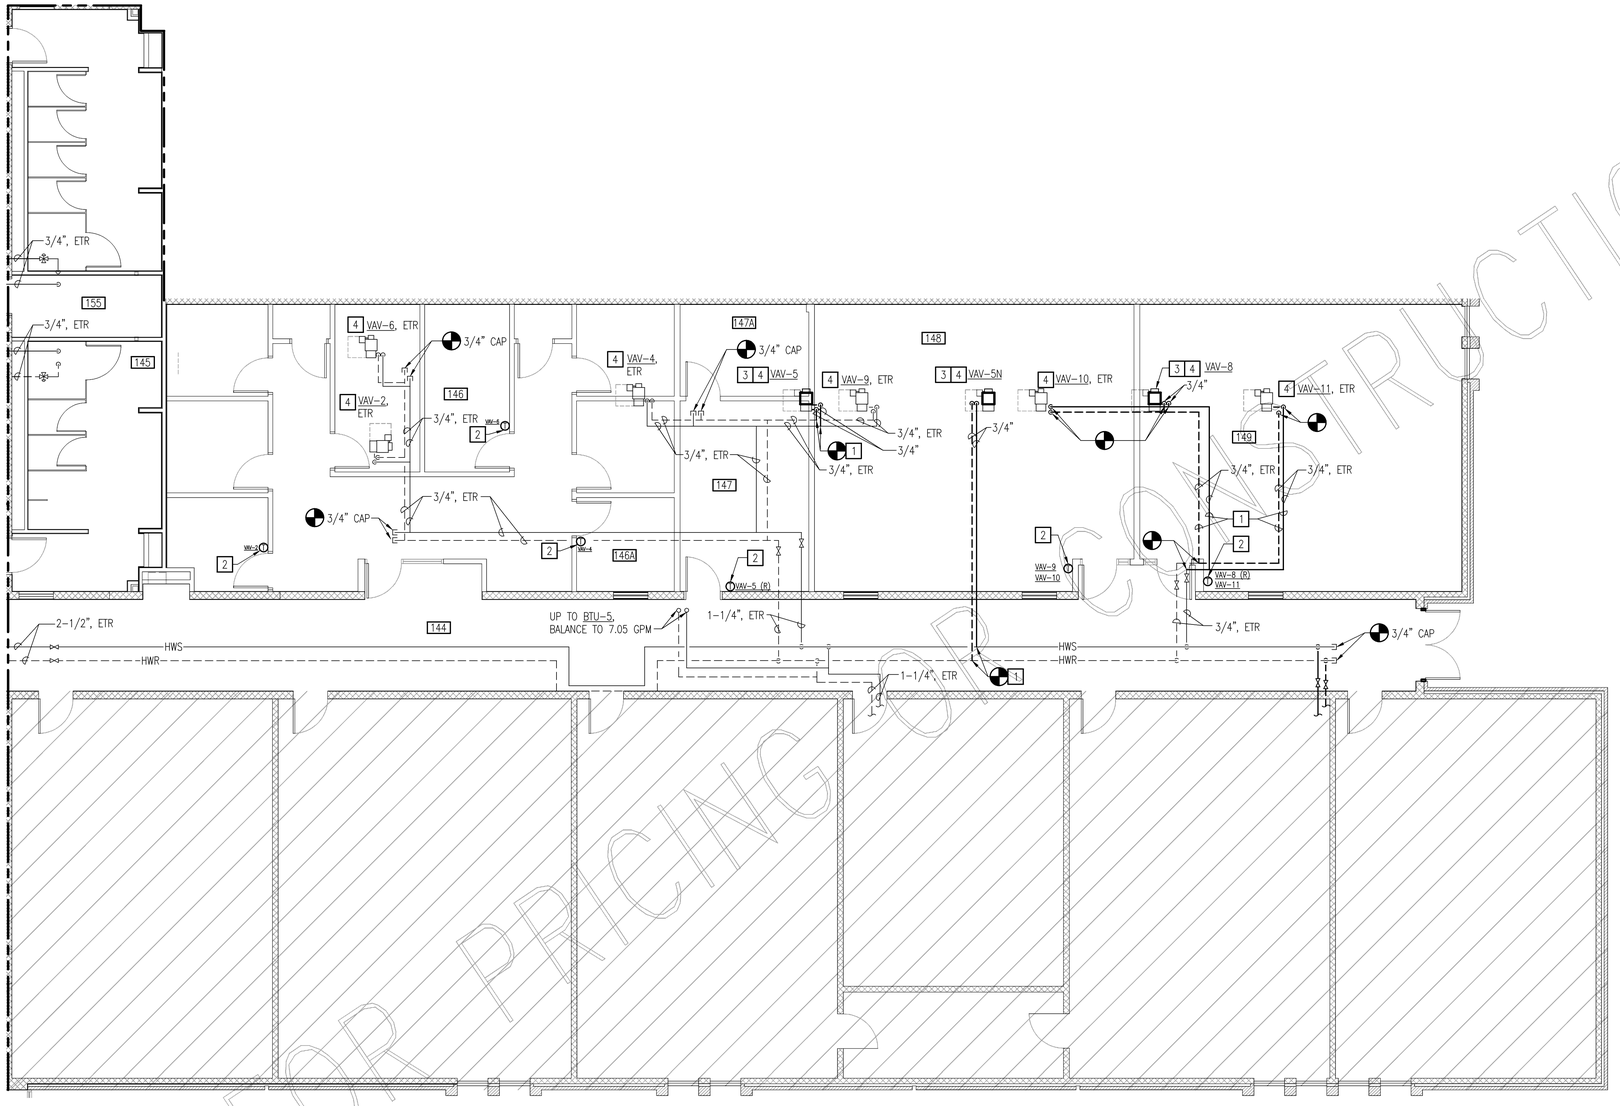

NEW WORK FLOOR PLAN - MECHANICAL PIPING

SCALE: 3/16" = 1'-0"

SECTION 4 ROOM SCHEDULE

144	CORRIDOR
145	MENS
146	OPEN OFFICE
146A	HUDDLE
147	OPEN OFFICE
147A	OFFICE
148	COMPUTER CLASSROOM
149	COMPUTER CLASSROOM
154	WOMENS
155	JANITOR



KEYPLAN
NO SCALE

PAGE COLLABORATIVE
MECHANICAL ELECTRICAL ENGINEERS
VIRGINIA BEACH, VA - 757-499-7333

GRAPHIC SCALES

3/16" = 1'-0" 0' 5' 10' 20'

NOT FOR PRICING OR CONSTRUCTION

nbj ARCHITECTURE
A Professional Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Richmond, Virginia 23059
(804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260-17712

WARSAW CAMPUS
NEW WORK FLOOR PLAN - MECHANICAL PIPING

Date: JANUARY 13, 2010

REVISIONS

NO.	DATE

COMMONWEALTH OF VIRGINIA
JOHN M. NEWELL
Lic. No. 035329
01.13.10
PROFESSIONAL ENGINEER

Sheet
M2.4W

File Number
XX